


1. THIS DETAIL IS TO SHOW INSTALLATION OF SERVICE LINES FOR 3/4" AND 1" SERVICES WHEN CROSSING PAVEMENT. SERVICE LINES 1-1/2" AND ABOVE CROSSING PAVEMENT SHALL BE DESIGNED ON A CASE-BY-CASE BASIS.
2. ALL OTHER DETAILS REGARDING METER INSTALLATION SHALL BE PER THE APPROPRIATE STANDARD DETAIL COVERING THE SERVICE TYPE AND SIZE.
3. ALL MATERIALS SHALL BE PER APPROVED MATERIALS LIST.
4. SERVICE SHALL BE COPPER TUBE SIZE POLYETHYLENE (PE) 4710, SDR-9 (200 psi), OR "K" TYPE COPPER, .
5. WHENEVER SIDEWALK EXISTS OR IS PROPOSED, MODIFY METER LOCATION AS DIRECTED BY PSA.
6. FOR 3/4" OR 1" SERVICE LINE, USE 2" PVC OR HDPE CARRIER PIPE FOR SERVICE LINE - INSTALL UNDER PAVEMENT FROM EDGE TO EDGE VIA JACKING OR BORING. FOR 2" SERVICE LINE, SEE CASING REQUIREMENTS AND DETAIL.

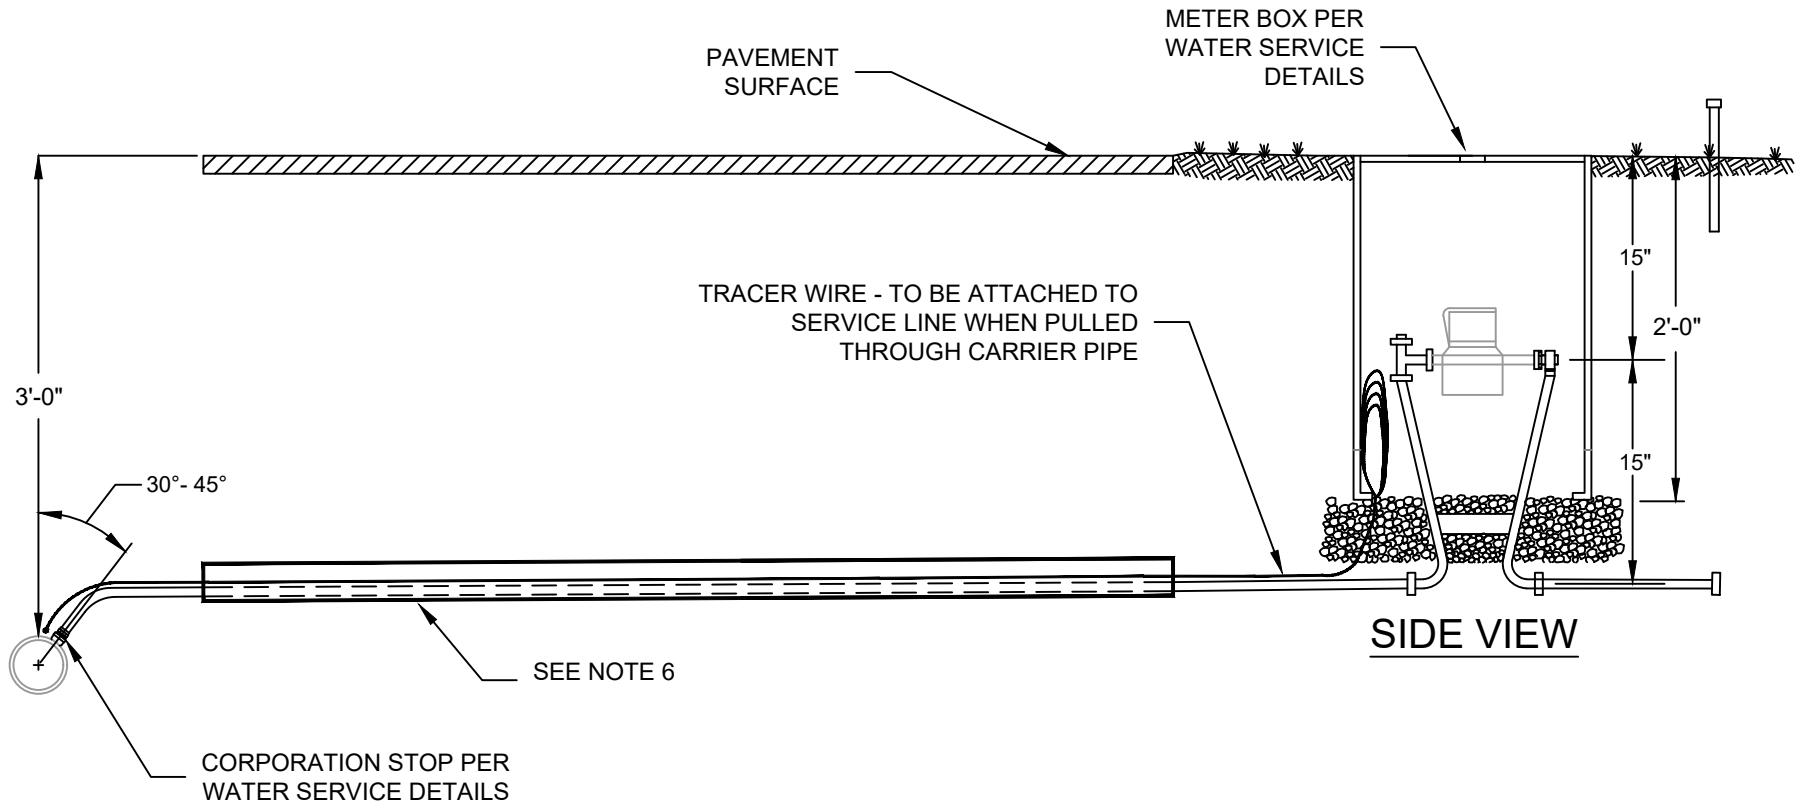

WATER SERVICE PAVEMENT CROSSING

EFFECTIVE
07/2024

DETAIL NO.
207